


JP / JP PM JP PT-V / JP PT-H



Further product documentation
net.grundfos.com/qr/i/99520338

be
think
innovate

GRUNDFOS 



Min./Max. 0/40 °C (S3: 60 °C)
Min./Max. 32/104 °F (S3: 140 °F)



$P_{\max} = 6 \text{ bar (87 psi)}$




- Voltage [V]
- Frequency [Hz]
- Connection: GAS / NPT

Min./Max. 0/40 °C (S3: 55 °C)
Min./Max. 32/104 °F (S3: 131 °F)






JP

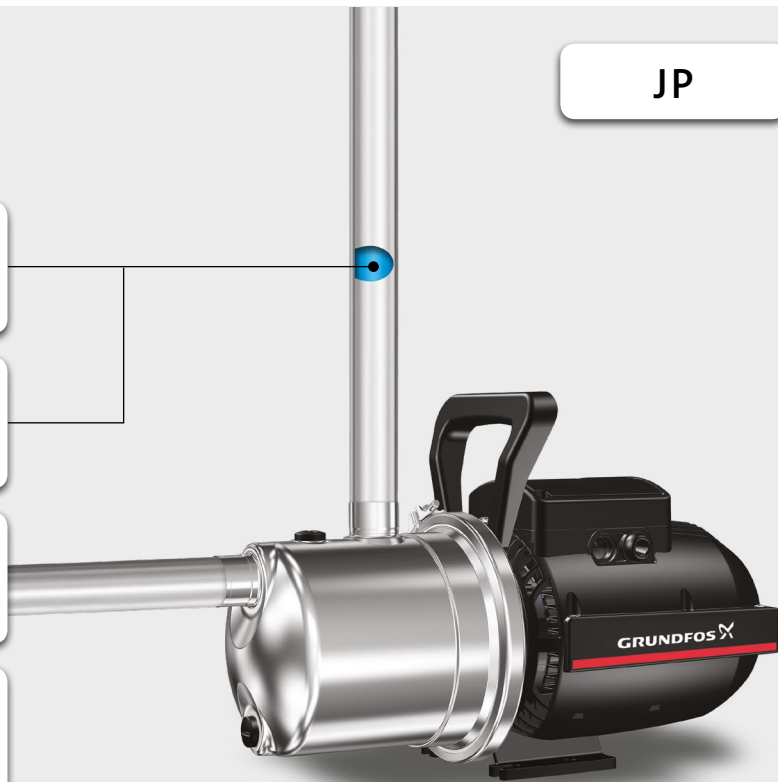


JP

Max. 8 m / 26 ft

$\geq 0.5 \text{ m} / 1.64 \text{ ft}$





Min./Max. 0/40 °C (S3: 60 °C)
Min./Max. 32/104 °F (S3: 140 °F)



$P_{\max} = 6 \text{ bar (87 psi)}$



- Voltage [V]
- Frequency [Hz]
- Connection: GAS / NPT


Min./Max. 0/40 °C (S3: 55 °C)
Min./Max. 32/104 °F (S3: 131 °F)



JP PM



$P_{\text{start}} = 1.5 \text{ bar (22 psi)}$

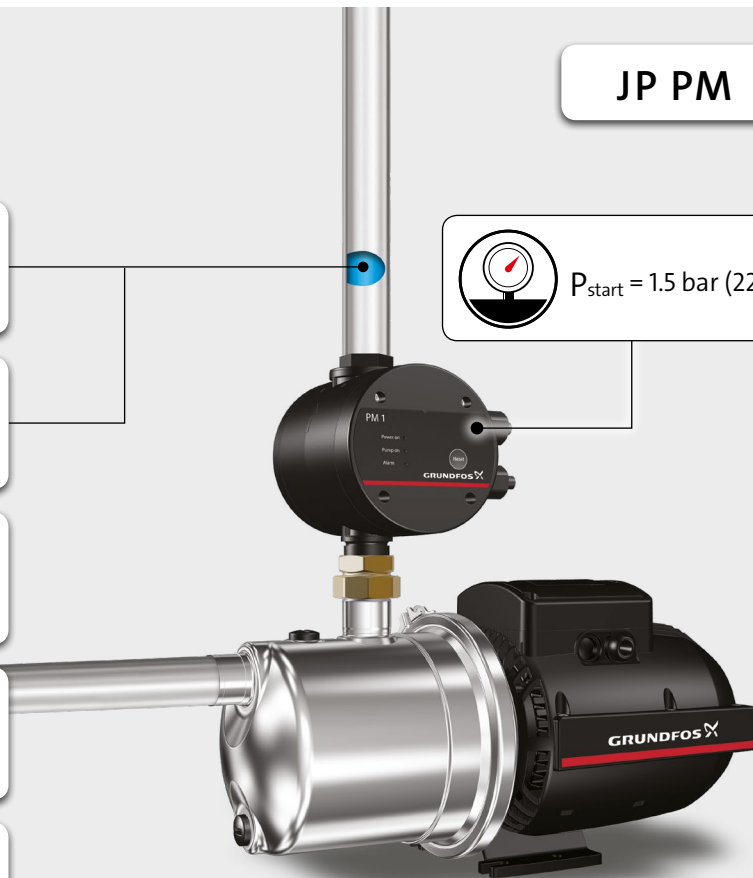


JP PM

Max. 10 m

Max. 8 m / 26 ft

The diagram illustrates the correct and incorrect wiring for a Grundfos JP PM pump. A horizontal pipe runs across the top, with a correct connection (marked with a green checkmark) and an incorrect connection (marked with a green X). The pump is shown with a vertical pipe leading down into a well. The distance from the pump to the well is labeled as 'Max. 10 m'. The distance from the well to the pump is labeled as 'Max. 8 m / 26 ft'. The pump is connected to a power source via a black cable, which is then connected to a switch labeled '0/Off' and '1/On'. The pump is labeled 'GRUNDFOS X'.

$\geq 0.5 \text{ m} / 1.64 \text{ ft}$



Min./Max. 0/40 °C (S3: 60 °C)
Min./Max. 32/104 °F (S3: 140 °F)



$P_{\max} = 6 \text{ bar (87 psi)}$




- Voltage [V]
- Frequency [Hz]
- Connection: GAS

Min./Max. 0/40 °C (S3: 55 °C)
Min./Max. 32/104 °F (S3: 131 °F)



JP PT-V

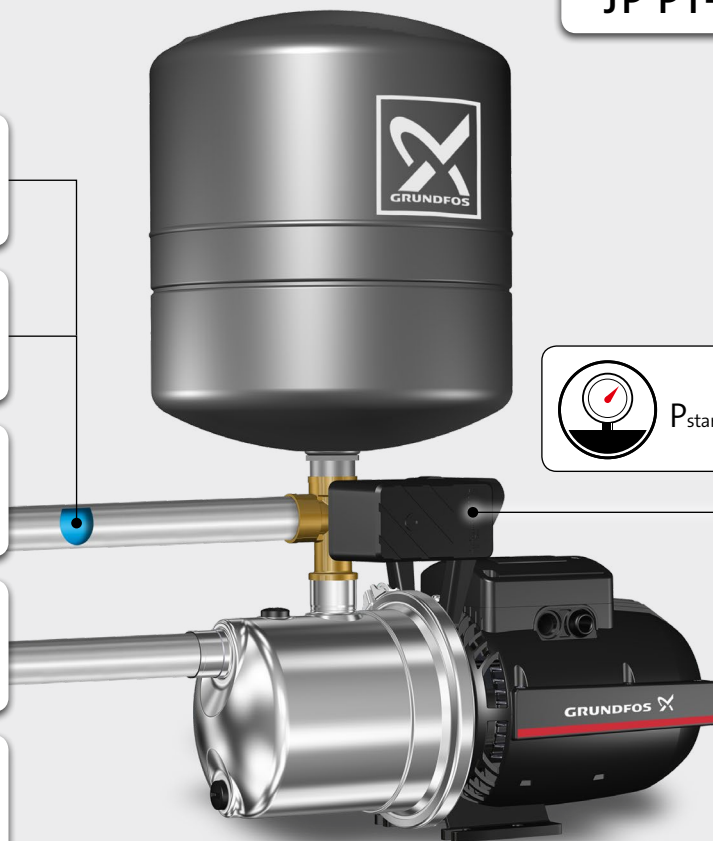


$P_{\text{start}} = 2.2 \text{ bar}$


JP PT-V

(32 psi)

Max. 8 m / 26 ft

$\geq 0.5 \text{ m} / 1.64 \text{ ft}$

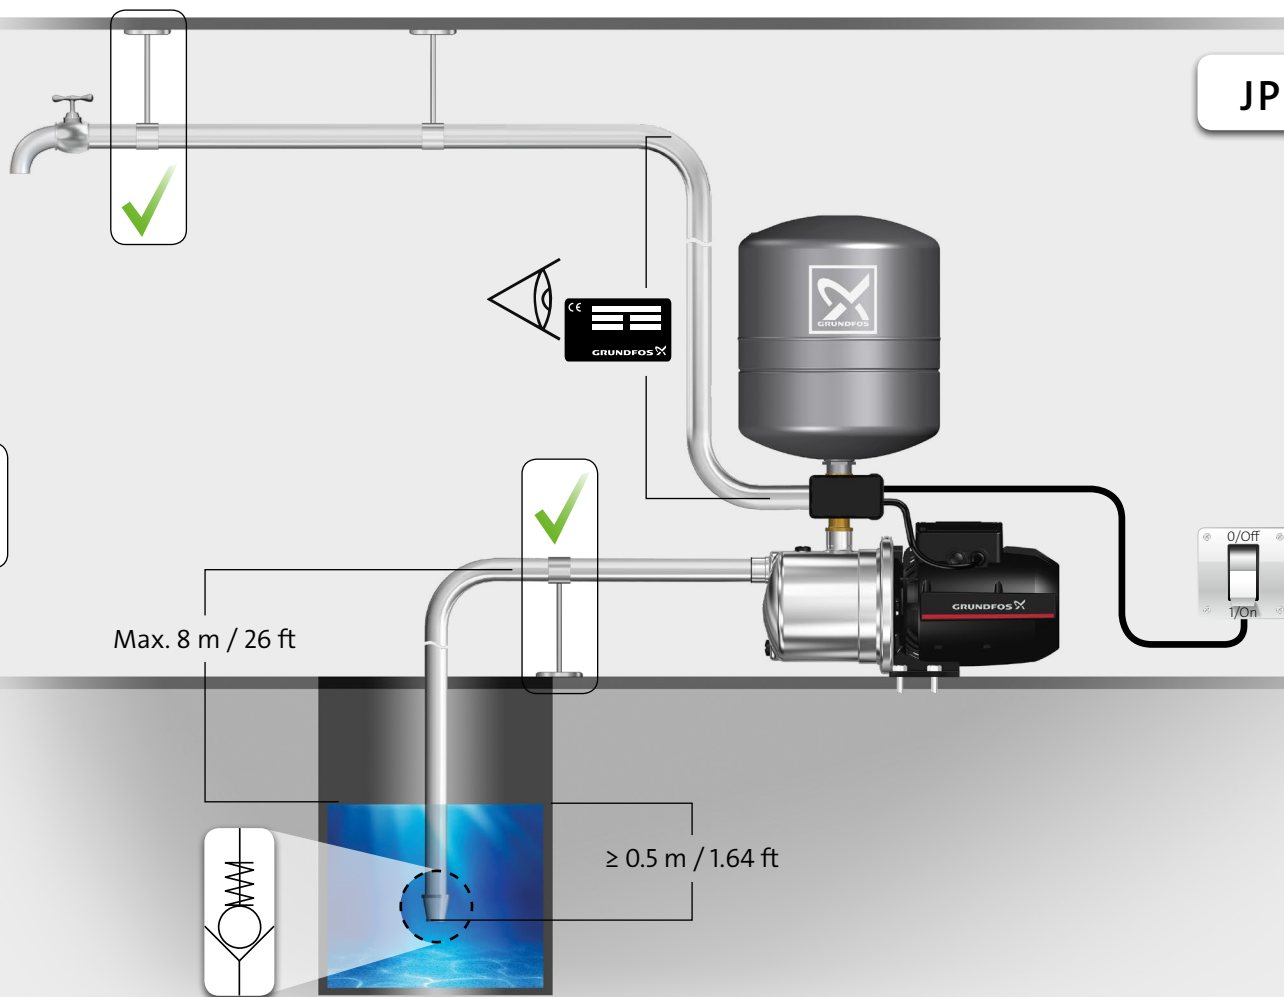



Min./Max. 0/40 °C (S3: 60 °C)
Min./Max. 32/104 °F (S3: 140 °F)



$P_{\max} = 6 \text{ bar (87 psi)}$



- Voltage [V]
- Frequency [Hz]
- Connection: GAS


Min./Max. 0/40 °C (S3: 55 °C)
Min./Max. 32/104 °F (S3: 131 °F)



JP PT-H



$P_{\text{start}} = 2.2 \text{ bar}$

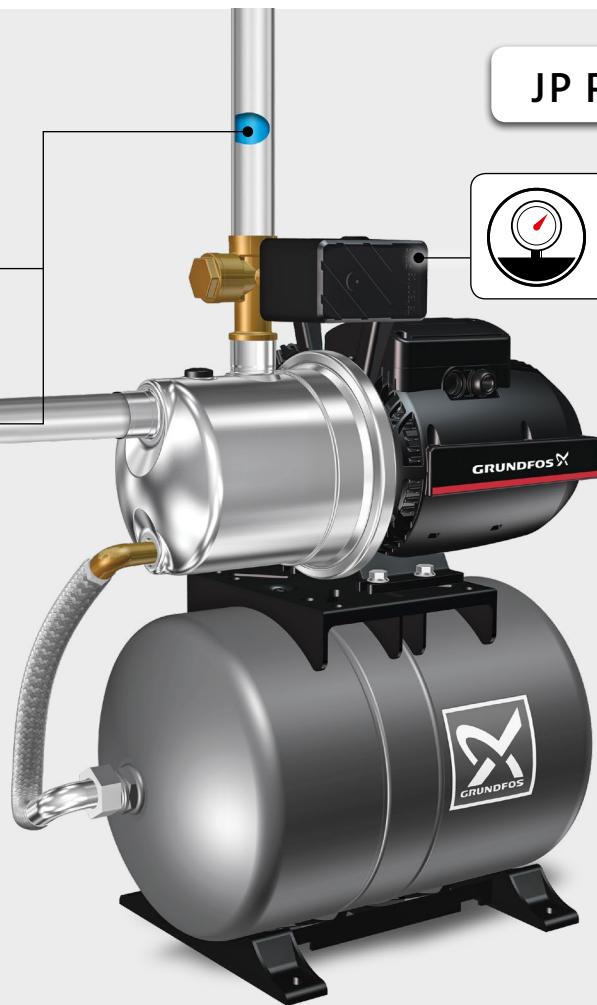



JP PT-H

(32 psi)

Max. 8 m / 26 ft

≥ 0.5 m / 1.64 ft

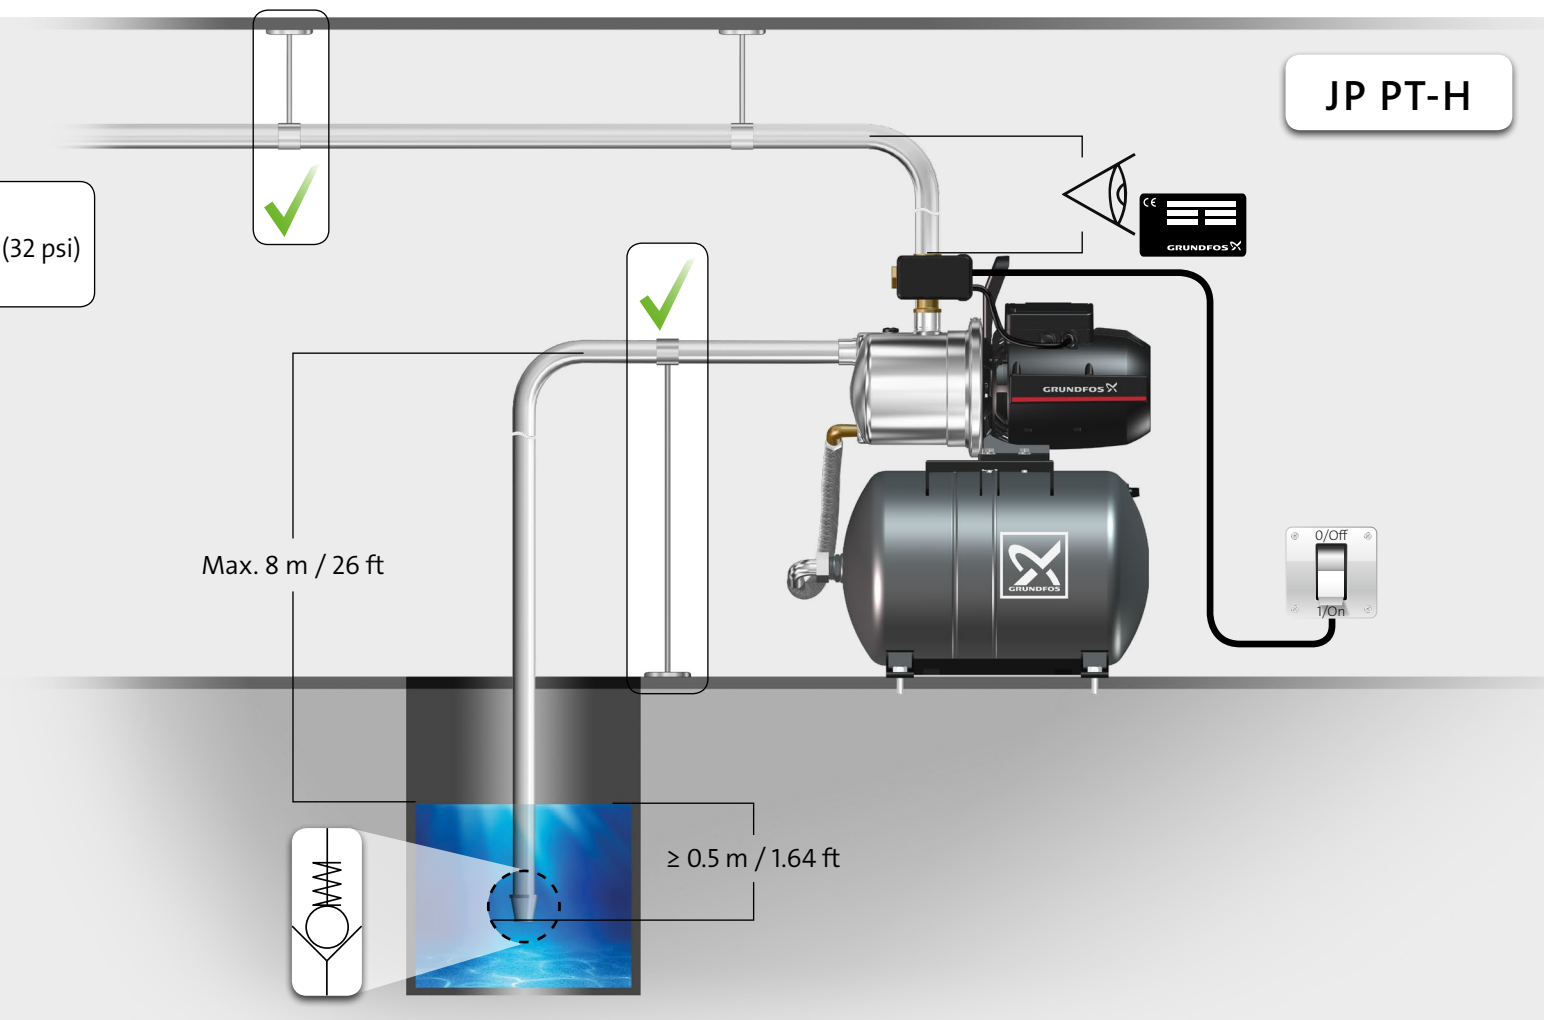



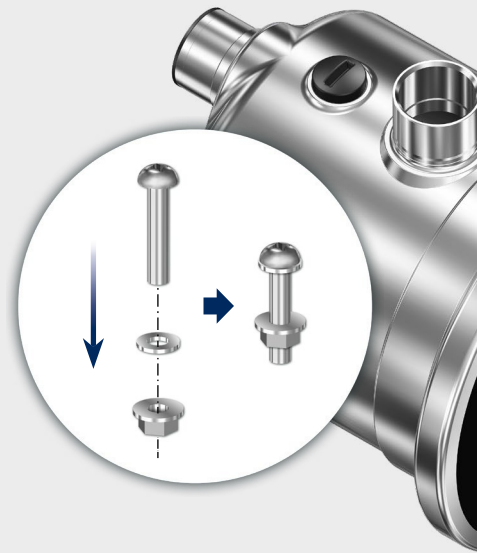


JP



1A




JP / JP PM/ JP

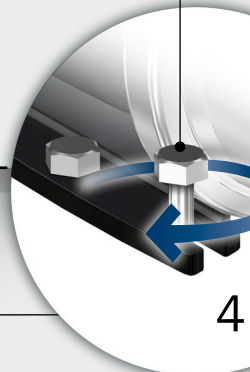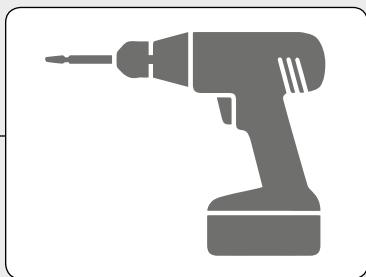

PT-V

1B



JP PT-H

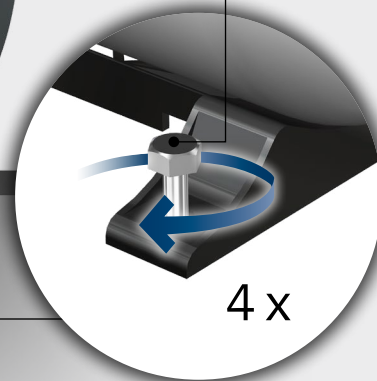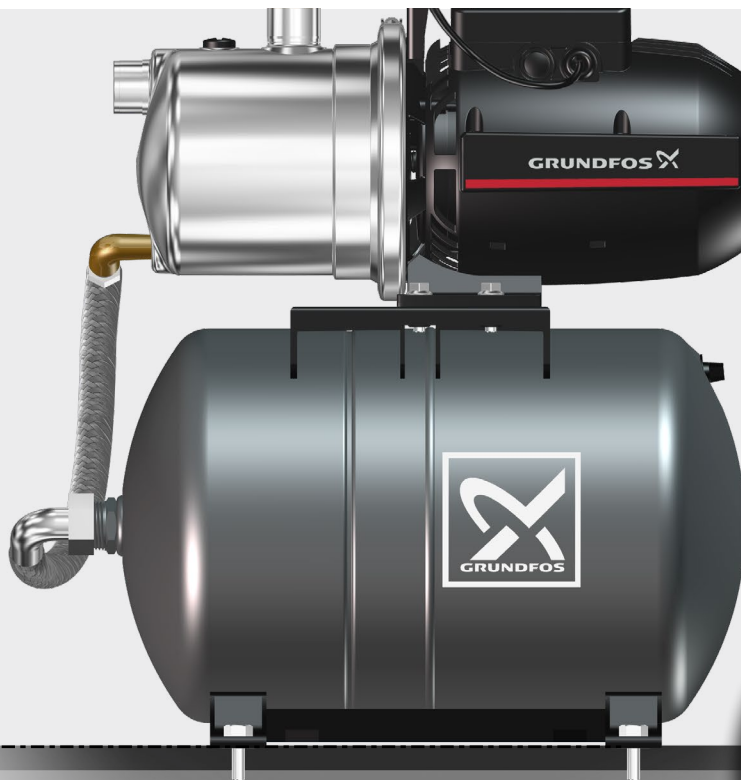




4 x



2a







JP






2b




JP PM

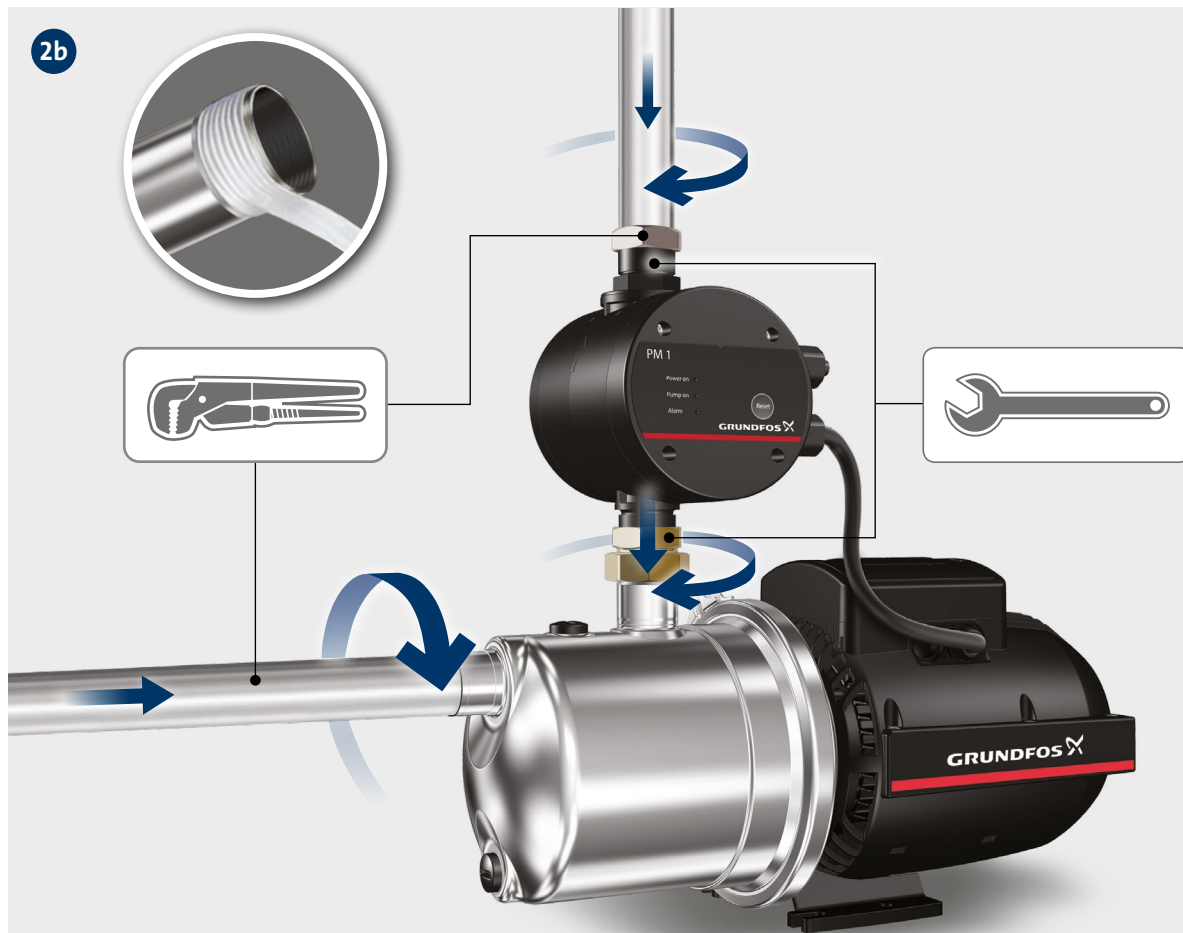

2c


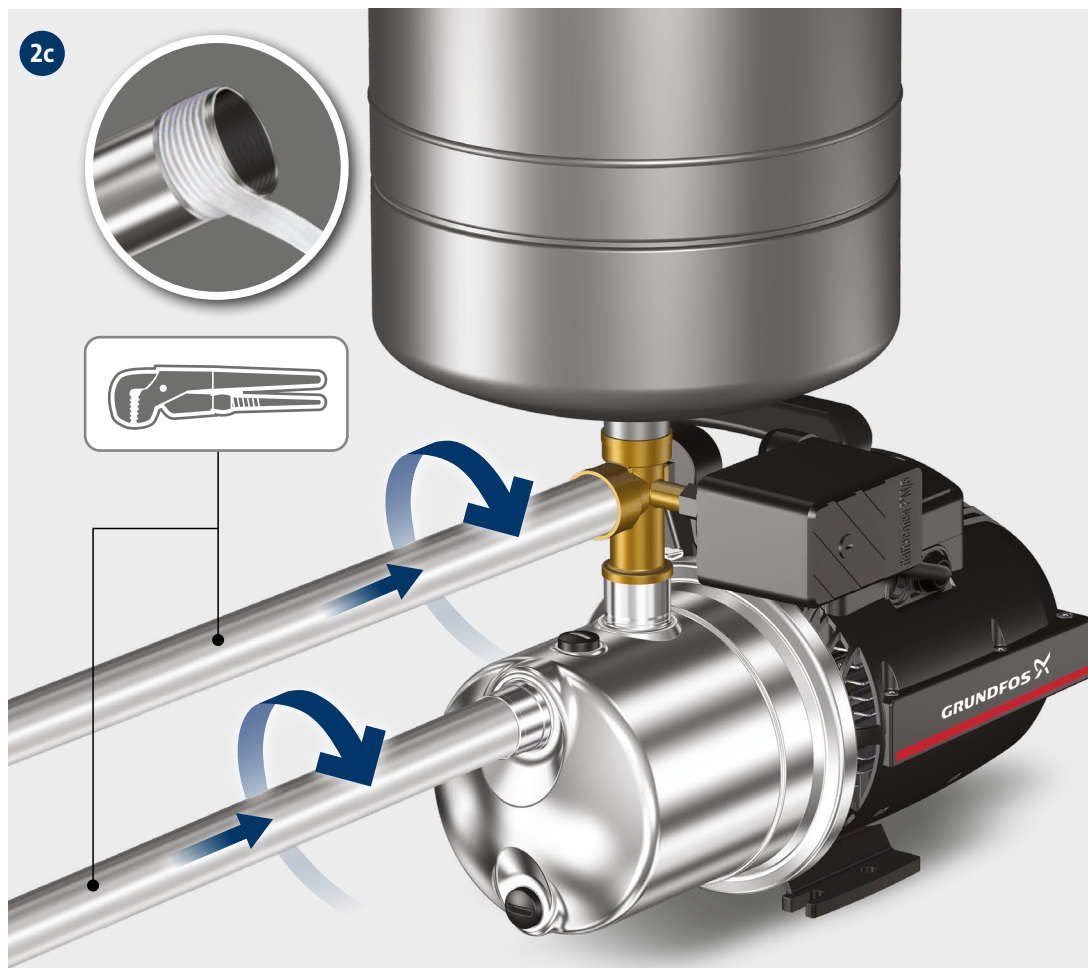




JP PT-V



2d

JP PT-H

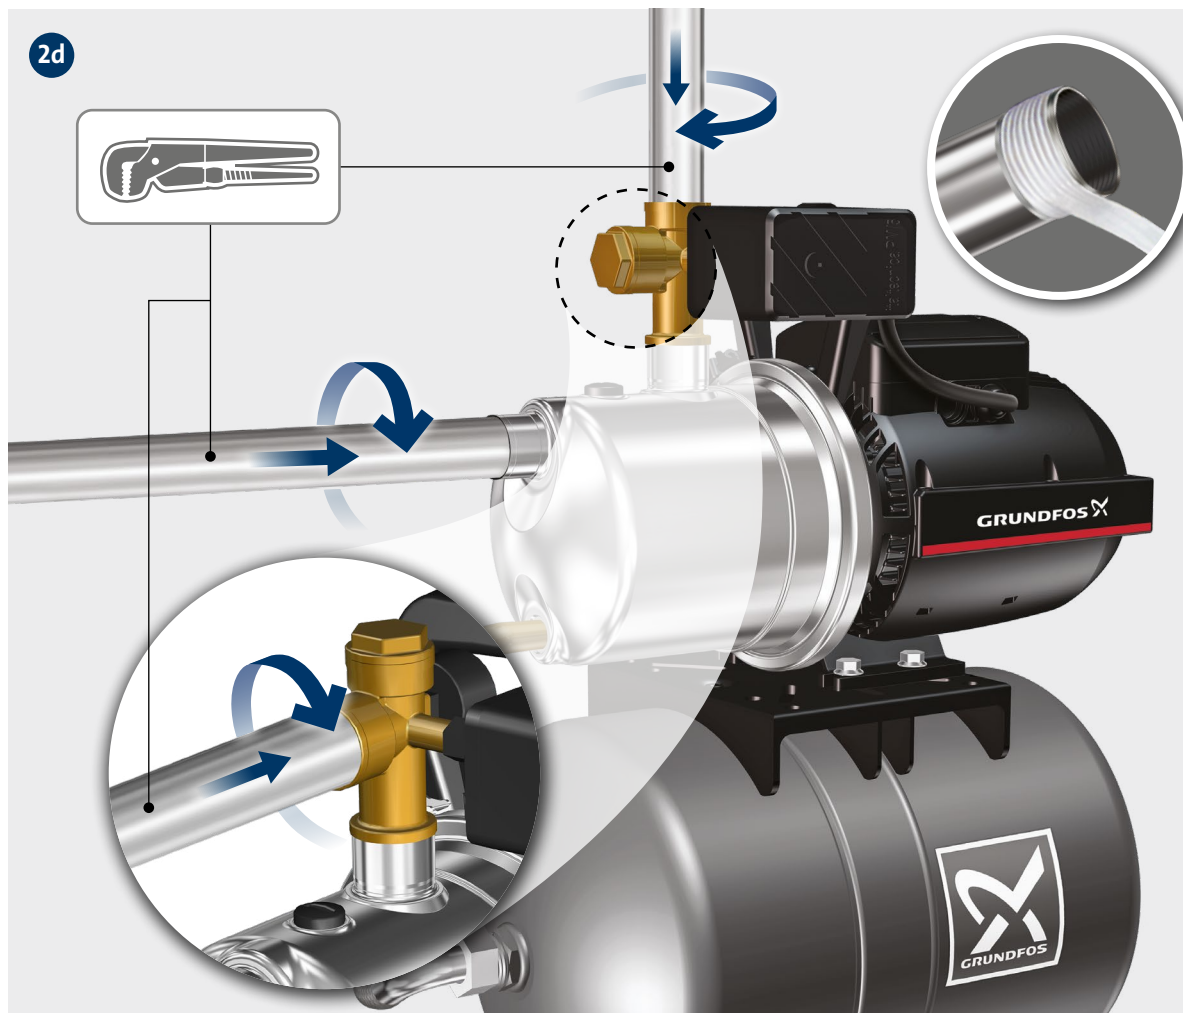




3

JP / JP PM / JP PT-V / JP PT-H



4

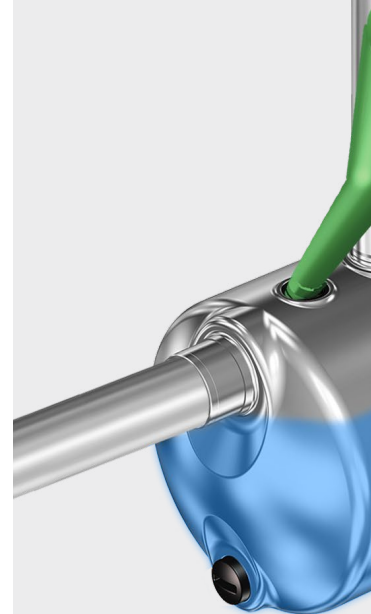










JP / JP PM / JP PT-V / JP PT-H



9

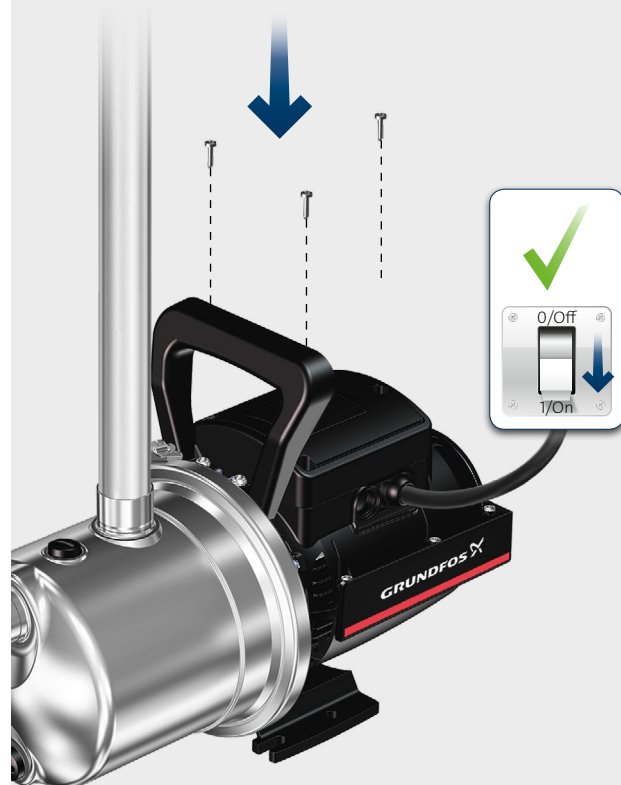



JP PM

Reset



net.grundfos.com/qr/i/99520338



JP / JP PM / JP PT-V / JP PT-H



be think innovate

Installation date: _____

Installer:

99544277 1218

ECM: 1249679

GRUNDFOS Holding A/S
Poul Due Jensens Vej 7
DK-8850 Bjerringbro
Tel: +45 87 50 14 00
www.grundfos.com

GRUNDFOS 

Trademarks displayed in this material, including but not limited to Grundfos, the Grundfos logo and "be think innovate" are registered trademarks owned by The Grundfos Group. All rights reserved.
© 2018 Grundfos Holding A/S, all rights reserved.