

Brandhaspels

De brandhaspels met handbediende afsluiter zijn eigentijds vormgegeven en zijn leverbaar voor vaste en zwenkbare montage. Er is keuze uit verschillende inbouwdieptes en bladdiameters.

Brandslanghaspels zijn geschikt voor branden van klasse **A**

Brandslanghaspels moeten, afhankelijk van de brandrisico's en omgeving, minimaal eenmaal per jaar in overeenstemming met de onderhoudsnorm worden gecontroleerd door een gediplomeerd onderhoudsmonteur. Bovendien moet eens in de vijf jaar de haspelslang afgeperst worden.

Toepassingen brandhaspels

Brandhaspels worden toegepast in alle type gebouwen zoals:

- Kantoren
- Openbare gebouwen
- Tunnels
- Industrie
- Scholen
- Ziekenhuizen

Voordelen van brandhaspel

- Onbeperkte blustoevoer
- Snel inzetbaar
- Eenvoudige bediening

Keuringen

- CE-keur
- KIWA-keur
- voldoen aan de Europese norm NEN-EN 671-1
- NVBB-ANPI gekeurd



Gamma CRICO brandhaspels

Technische beschrijving – Algemeenheden

- De haspel is conform de norm EN 671-1: 2012.
- De haspelflenzen zijn op de binnen- en buitenzijde kras- en stootvast geëpoxeerd in signaalrode RAL 3000 en gemoffeld.
- De haspelflenzen zijn uit staalplaat 15/10mm vervaardigd.
- De draaghuls, waarop de PVC slang wordt gewikkeld, heeft een minimum diameter van 207mm.
- De straalpijp is traploos verstelbaar en voorziet volgende standen: gebonden volle straal, sproeistraal en afsluitstand.
- De brandslang, onder druk gesteld, rolt soepel uit tot de gewenste slanglengte. Een wrijvingsrem voorkomt losse slanglussen.
- De brandslang heeft een diameter van 3/4" en een lengte van 20m of 1" en een lengte van 30m.
- De toevoerafsluiter is een bolkraan, met kwartdraai bediening en uitgevoerd in verchroomd messing.
- Een speciaal dispositief op de toevoerafsluiter vergrendelt de straalpijp. Pas na het openen van de afsluiter kan de straalpijp worden vrijgemaakt.


Voor wat betreft de zwenkbare haspel

- Bij het trekken aan de slang zwenkt de haspel automatisch uit in de richting waarin de slang getrokken wordt. Dit bevordert de snelheid en het gemak van ontrollen van de slang.
- De haspel kan 180° om zijn verticale as draaien zodat hij in alle richtingen kan ontrollen worden.
- De haspel is bevestigd aan een zwenkarm die aan de muur vastgemaakt is op een breed-dragende muurplaat.
- De draagarm dient niet als voedingsleiding. De voeding zit onderaan.
- Aan het spuitstuk en de slang is een beschermingsbuis voorzien om verwonding van de handen te vermijden.
- De slang aan de binnentrommel is voorzien van een spiraal om het knikken van de slang aan de trommel te verhinderen.


MODELLEN MUURHASPELS CRICO									
Omschrijving	BGS Artikelnummer	Kleur	Plaat dikte	Diameter slang	Lengte slang	Afmetingen			
						Hoogte	Breedte	Diepte	Diameter
Vast model 20m	CR-HAS20VN	Rood RAL3000	15/10mm	3/4"	20m	747mm	600mm	155mm	600mm
Zwenkbaar model 20m	CR-HAS20ZN	Rood RAL3000	15/10mm	3/4"	20m	600mm	700mm	155mm	600mm
Vast model 30m	CR-HAS30VN	Rood RAL3000	15/10mm	1"	30m	747mm	600mm	225mm	600mm
Zwenkbaar model 30m	CR-HAS30ZN	Rood RAL3000	15/10mm	1"	30m	600mm	700mm	225mm	600mm

Modellen


Vast model 20m

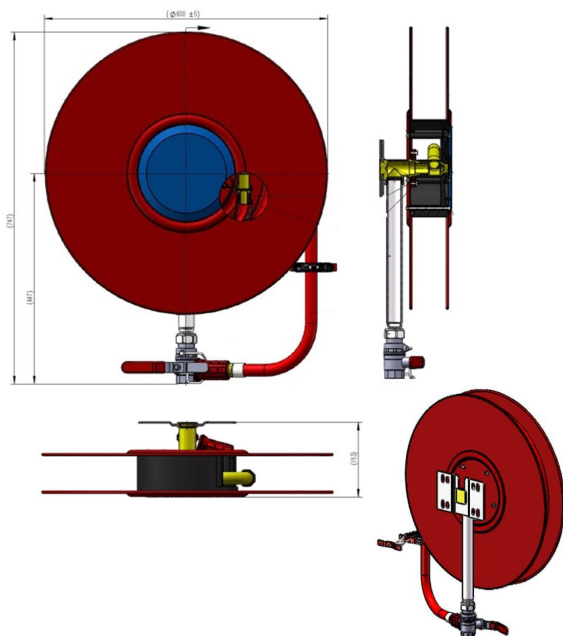


Zwenkbaar model 20m

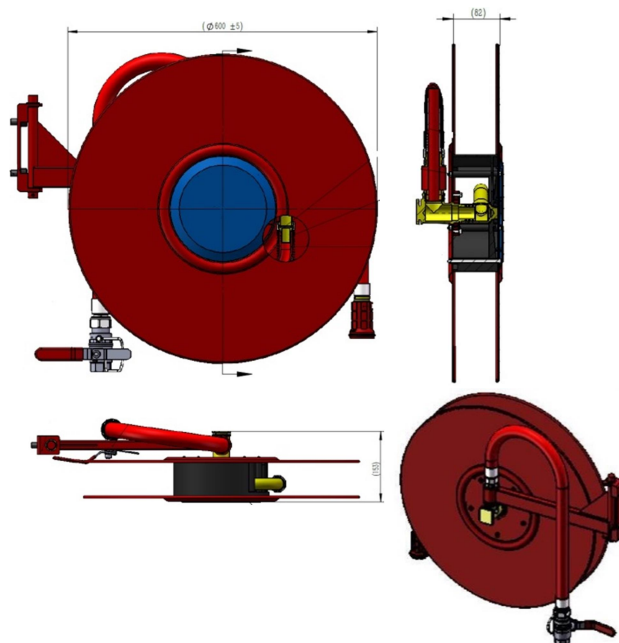

Vast model 30m

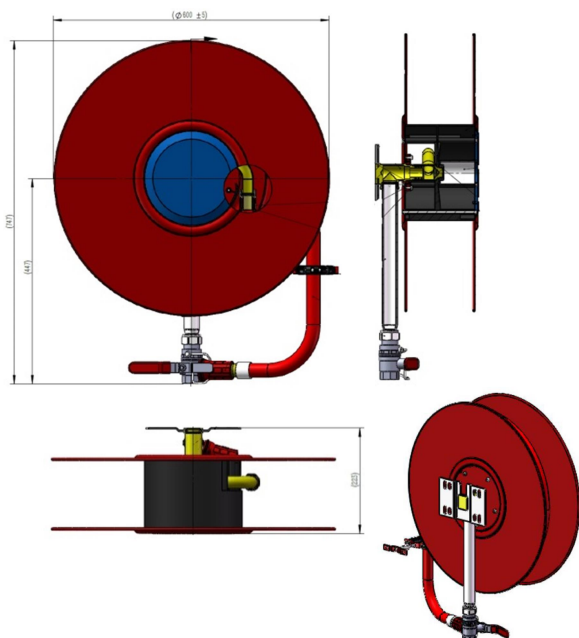

Zwenkbaar model 30m

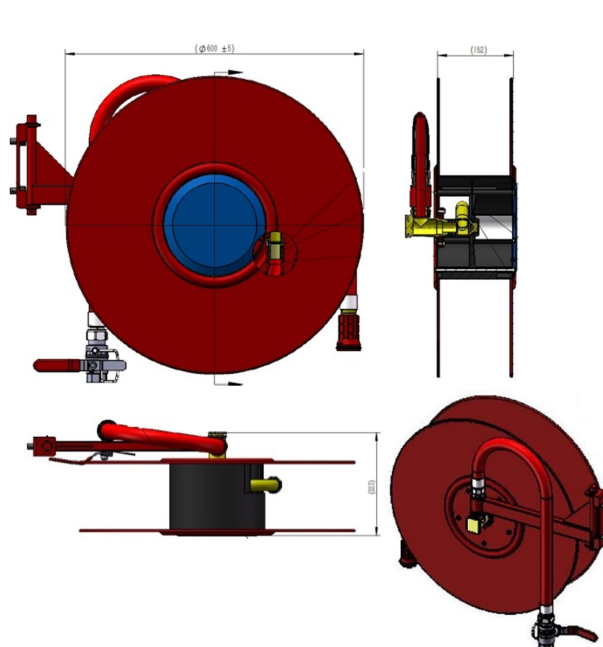

Opmerking:

De afstand tussen de toevoerleiding en begane grond dient zich tussen 80 en 110 cm te situeren.



LPCB®

www.redbooklive.com

Certificate of Product Approval

Certificate Number: 1038AHa

Issue: 01

BGS nv

Bleyveld 10
3320 Hoegaarden
Belgium

is certified by BRE Global Ltd. and is authorised to use the LPCB mark in association with the product(s) listed in this certificate and appendix having complied with the requirement(s) of the standards as detailed below.

Products

'BGS' Fire Hose Reels

(Refer to attached appendix for details)

Standards

EN 671-1:2012

Fixed firefighting systems. Hose systems. Hose reels with semi-rigid hose

This certificate and appendix is maintained and held in force through regular surveillance activities

S. A. Colwell

Signed for BRE Global Ltd

Sarah Colwell

Verifier

12 July 2017

Date of Issue

12 July 2017

Date of First Issue



This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms). To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.

BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 F: +44 (0)1923 664603 E: enquiries@breglobal.com
LPCB is a Registered Trademark of the Building Research Establishment Ltd.



bre

LPCB®

Appendix to Certificate No: 1038AHa
BGS nv

Issue: 01

'BGS' Fire Hose Reels to EN 671-1:2012

Product Name	Description	Hose Nominal Bore (mm)	Hose Maximum Length (m)	Nozzle type	LPCB Ref. No.
HAS20ZN	Manual, swinging arm, cabinet or wall mounted	19	30	Lever operated jet only or rotary operated jet/spray	1038AHa/01
HAS30ZN	Manual, swinging arm, cabinet or wall mounted	25	30	Lever operated jet only or rotary operated jet/spray	1038AHa/02
HAS20VN	Manual, fixed, wall mounted	19	30	Lever operated jet only or rotary operated jet/spray	1038AHa/06
HAS30VN	Manual, fixed, wall mounted	25	30	Lever operated jet only or rotary operated jet/spray	1038AHa/07

This certificate and appendix is maintained and held in force through regular surveillance activities

SAColwell

Signed for BRE Global Ltd.

Sarah Colwell
Verifier

12 July 2017
Date of issue

12 July 2017
Date of first issue



This certificate and appendix remains the property of BRE Global Ltd. and is issued subject to terms and conditions (for details visit www.redbooklive.com/terms). To check the validity of this certificate and appendix please visit www.redbooklive.com/check, scan the QR tag or contact us.
BRE Global Ltd, Watford, WD25 9XX
T: +44 (0)333 321 8811 F: +44 (0)1923 664603 E: enquiries@breglobal.com
LPCB is a Registered Trademark of the Building Research Establishment Ltd.



bre